



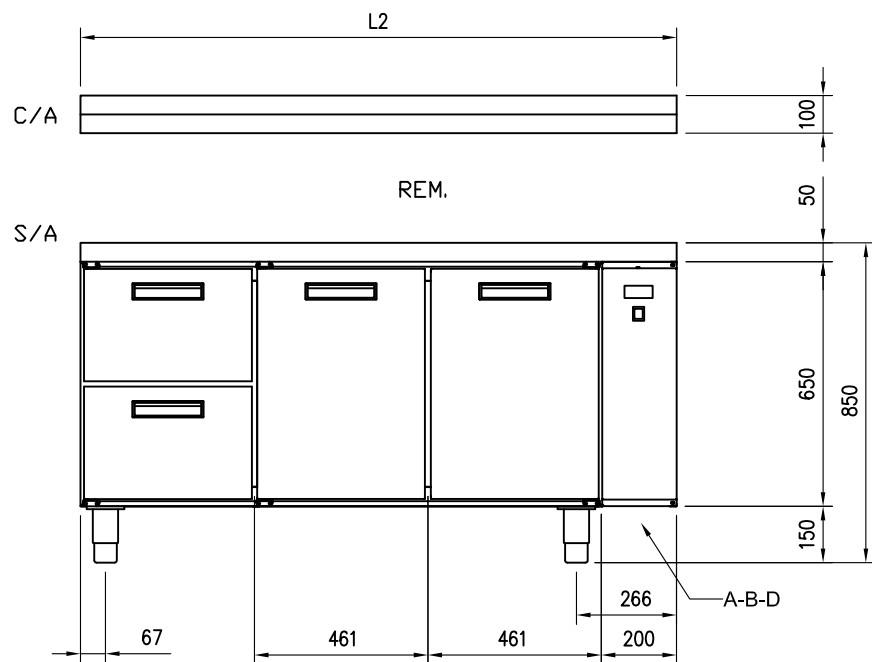

LINEAR
 A= ELECTRICAL CONNECTION
 B= GAS CONNECTION $\varnothing 8$ $\varnothing 10$
 D= WATER DISCHARGE $\varnothing 20$ (M)
 INSULATION THICKNESS 50 MM

	L1	L2
2-	1260	1124
3-	1721	1585
4-	2182	2046

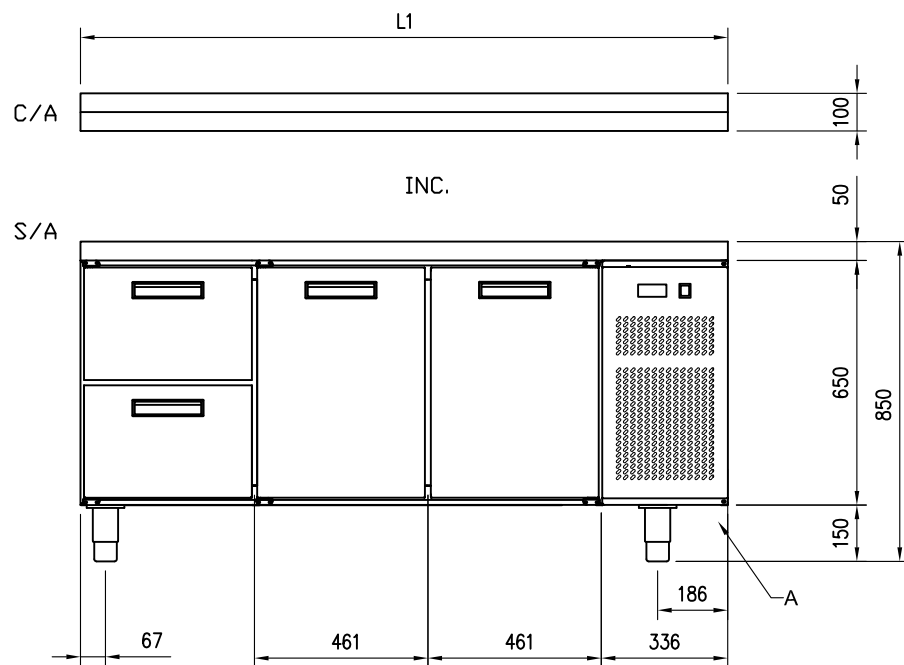